

DIRIS A-20

Power Monitoring Device - PMD

measurement and monitoring - door mounting



DIRIS A-20

Function

DIRIS A-20 units are Power Metering and Monitoring Devices (PMD) that provide the user with all of the measurements needed to complete energy efficient projects successfully and to provide assured monitoring of electrical distribution.

All of this information can be used and analysed remotely using energy efficiency software packages.

Advantages

User-friendly operation

- Thanks to its large backlit multi-screen display with 4 hotkeys, the DIRIS A-20 is easy to use.

Compliant with IEC 61557-12

- Reference standard for PMDs (Power metering & monitoring devices), Standard IEC 61557-12 guarantees performance levels and satisfactory performance from the PMDs under the environmental conditions typical of industrial and tertiary applications.

Detects wiring errors

- The DIRIS A-20 has an error correction function for CT connections.

Customisable

- Additional communication and input/output modules can extend the basic functional scope of this product. Equipped with additional modules, the DIRIS A-20 can provide the user with flexibility and expandability throughout the service life of the product.

The solution for

- > Healthcare
- > Energy
- > Industry



Strong points

- > User-friendly operation
- > Compliant with standard IEC 61557-12
- > Detects wiring errors
- > Customisable

Conformity to standards

- > IEC 61557-12
- > IEC 62053-22 Class 0.5S
- > IEC 62053-23 class 2
- > UL



Associated software

- > To use Socomec PMDs effectively, we can offer you several dedicated software tools.

See "Easy Config System" pages.

Associated products



Current transformers


RGW Sensors

RAC-1A integrator

Sustainable advantages

- > 30-year calibration guarantee to avoid the need for recalibration or product replacement.
- > Includes ECO mode to reduce device energy consumption.
- > RoHS & REACH compliant.

Functional diagram

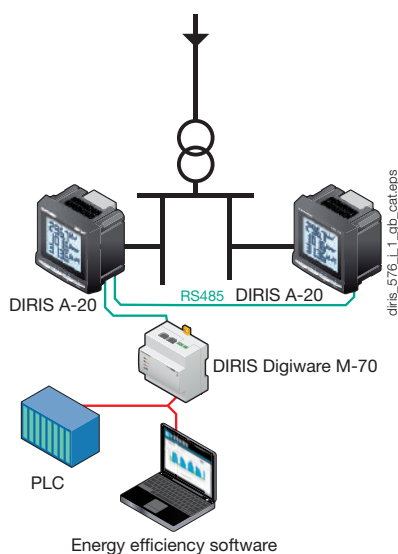

Functions

Multi-measurement

- Currents
 - instantaneous: I1, I2, I3, In
 - maximum average: I1, I2, I3, In
- Voltages & frequency
 - instantaneous: V1, V2, V3, U12, U23, U31, F
- Power
 - instantaneous: 3P, ΣP, 3Q, ΣQ, 3S, ΣS
 - maximum average: ΣP, ΣQ, ΣS
- Power factors
 - instantaneous: 3PF, ΣPF

Metering

- Active energy: +/- kWh
- Reactive energy: +/- kVarh
- Hours: ☉

Harmonic analysis

- Total harmonic distortion (up 51st)
 - Currents: thd I1, thd I2, thd I3
 - Phase-to-neutral voltage: thd V1, thd V2, thd V3
 - Phase-to-phase voltage: thd U12, thd U23, thd U31

Events

- Alarms on all electrical parameters

Communications (1)

- RS485 with MODBUS protocol
(1) Available as an option (see the following pages).


Input

- Information report from an external dry contact

Output


- Equipment control
- Alarm report
- Pulse report

Front panel

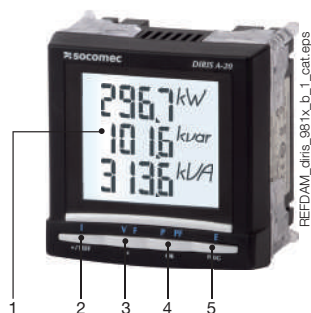

1. Backlit LCD display
2. Pushbutton for currents (instantaneous and maximum), currents THD and the connection correction function.
3. Pushbutton for voltages, frequency and voltages THD.
4. Pushbutton for power (instantaneous and maximum), and active, reactive and effective power factor.
5. Pushbutton for energy sources and time meters.

Case

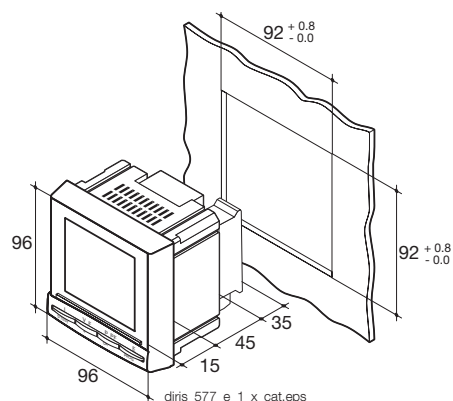

Type	Plug-in
Dimensions W x H x D	96 x 96 x 60 mm
Case Ingress Protection rating	IP30
Front panel Ingress Protection rating	IP52
Display type	Backlit LCD
Terminal blocks type	Fixed or removable
Cross-section for voltage connections and other terminals	0.2 ... 2.5 mm ²
Cross-section for current connections	0.5 ... 6 mm ²
Weight	400 g


DIRIS A-20

Power Monitoring Device - PMD

measurement and monitoring - door mounting

Optional snap-on modules

DIRIS® A-20

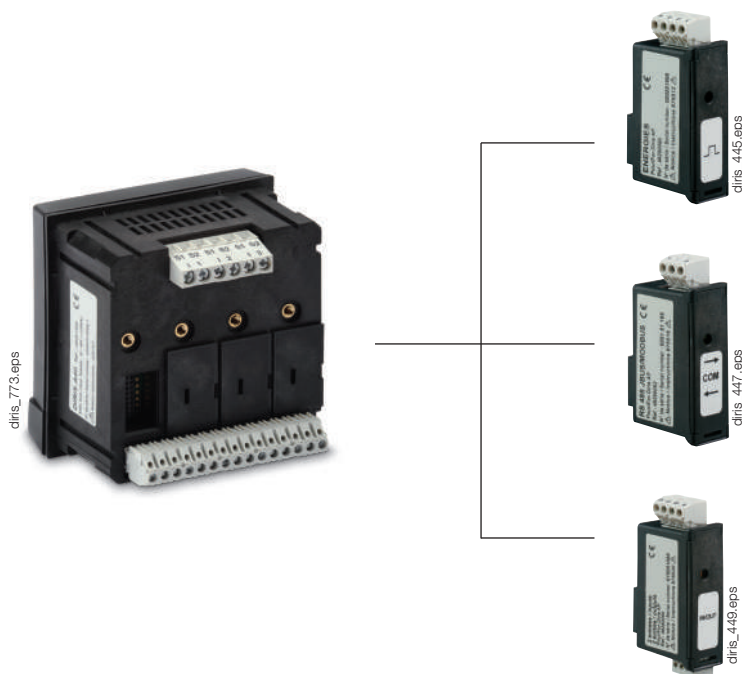

1 output

1 output that can be configured for:

- pulses: configurable (type, weight, duration) to kWh or kVarh.
- Monitoring: 3I, In, 3V, 3U, F, ΣP , ΣQ , ΣS , $\Sigma PFL/C$, THD 3I, THD 3V, THD 3U and time meter.
- Equipment control

Communication

RS485 link with MODBUS protocol
(transmission speed up to 38 400 bauds)

3 inputs , 1 output

3 inputs that can be configured into:

- Information report from an external dry contact


1 output that can be configured for:

- pulses: configurable (type, weight, duration) to kWh or kVarh.
- Monitoring: 3I, In, 3V, 3U, F, ΣP , ΣQ , ΣS , $\Sigma PFL/C$, THD 3I, THD 3V, THD 3U and time meter.
- Equipment control

Accessories

Current transformer

See "Current transformers" pages.

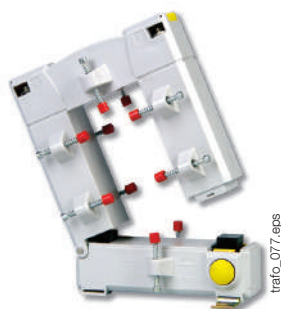

IP65 rating



Electrical characteristics


Current measurement (TRMS)		
Via CT primary		9999 A
Via CT secondary		5 A
Measurement range		0 ... 11 kA
Input consumption		0.6 VA
Measurement updating period		1 s
Accuracy		0.2%
Permanent overload		6 A
Transient overload		10 I _n over 1 s
Voltage measurements (TRMS)		
Direct measurement between phases		50 ... 500 V AC
Direct measurement between phase and neutral		28 ... 289 VAC
Input consumption		≤ 0.1 VA
Measurement updating period		1 s
Accuracy		0.2%
Power measurement		
Measurement updating period		1 s
Accuracy		0.5%
Power factor measurement		
Measurement updating period		1 s
Accuracy		0.5%
Frequency measurement		
Measurement range		45 ... 65 Hz
Measurement updating period		1 s
Accuracy		0.1%
Energy measurement accuracy		
Active (according to IEC 62053-22)		Class 0.5s
Reactive (according to IEC 62053-23)		Class 2
Auxiliary power supply		
AC voltage		110 ... 400 V AC
AC tolerance		±10%
DC voltage		120 ... 289 VDC
DC tolerance		±20%
Frequency		50 / 60 Hz
Power consumption		10 VA
Pulse or alarm output		
Number		1
Type		100 VDC - 0.5 A - 10 VA
Max number of operations		≤ 10 ⁸
Inputs		
Number		3
Power supply		10 ... 30 VDC
Minimum width of signal		10 ms
Minimum length between 2 pulses		18 ms
Type		Optocouplers
Communication		
Link		RS485
Type		2 to 3 half duplex wires
Protocol		MODBUS® RTU
MODBUS® speed		1400 ... 38400 bauds
Environment		
Operating temperature range		-10 ... +55 °C
Storage temperature		-20 ... +85 °C
Relative humidity		95%

DIRIS A-20

Power Monitoring Device - PMD

measurement and monitoring - door mounting


Terminals

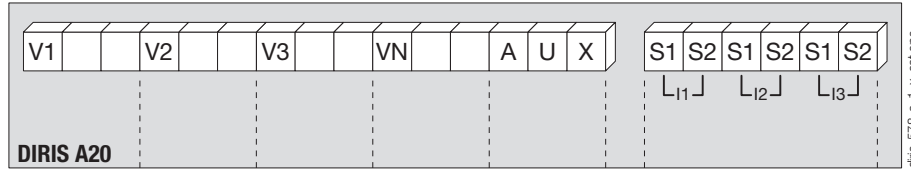

S1 - S2: current inputs.

AUX: auxiliary power supply U_s .
V1, V2, V3 & VN: voltage inputs.


Module communication

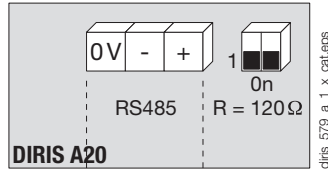

RS485 link.


R = 120 Ω: internal resistance for the RS485 link.

Output or alarm module

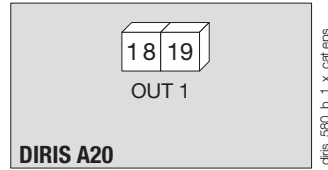

18 - 19: output n°1

Module with 3 inputs, 1 output

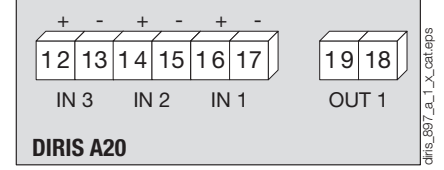


Connection

Low voltage balanced network

Recommendations

- For IT earthing systems, it is recommended that the CT secondary is not connected to earth.
- When disconnecting the DIRIS, the secondary of each current transformer must be short-circuited. This operation can be carried out automatically by a SOCOMEC PTI, which can be found in the SOCOMEC catalogue: please consult us.


3/4 wires with 1 CT

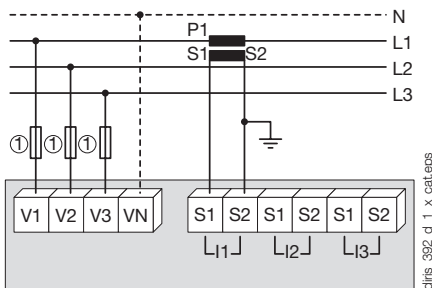

Use of 1 CT reduces by 0.5% the accuracy of the phases for which the current is deduced by vector calculation.


1. 0.5 A gG / 0.5 A class CC fuses.

Single-phase

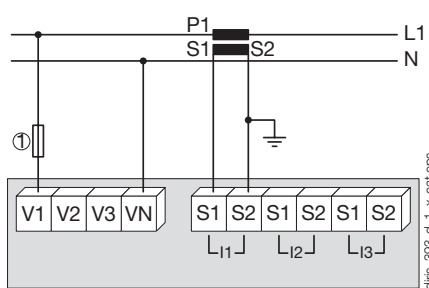

1. 0.5 A gG / 0.5 A class CC fuses.


Two-phase

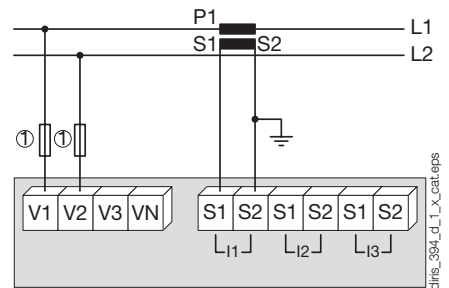

1. 0.5 A gG / 0.5 A class CC fuses.


Low voltage balanced network

3/4 wires with 3 CTs

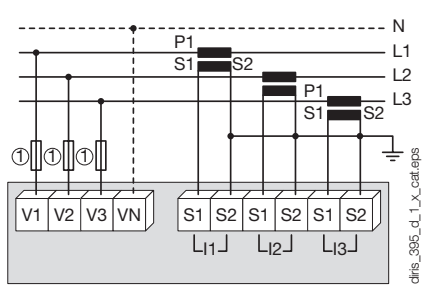

1. 0.5 A gG / 0.5 A class CC fuses.


3 wires with 2 CTs

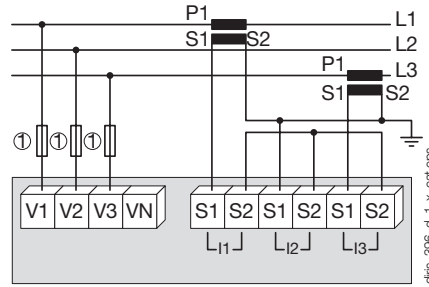

Use of 2 CTs reduces the accuracy by 0.5% for the phase for which the current is deduced by a vector calculation.

1. 0.5 A gG / 0.5 A class CC fuses.

3 wires with 2 CTs

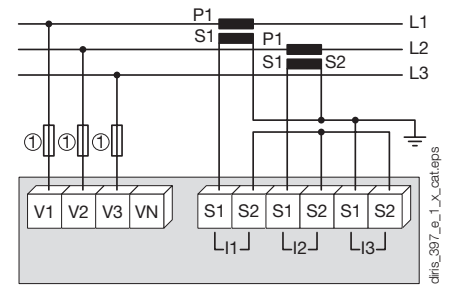


Use of 2 CTs reduces the accuracy by 0.5% for the phase for which the current is deduced by a vector calculation.

1. 0.5 A gG / 0.5 A class CC fuses.


Connection (continued)

Additional information

Communication via RS485 link

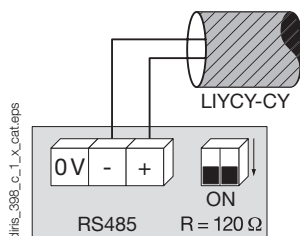

AC and DC auxiliary power supply



1. 0.5 A gG / 0.5 A class CC fuses.

References

Basic device	DIRIS A-20
Auxiliary power supply U_s	Reference
110 ... 400 VAC / 120 ... 350 VDC	4825 0402
Options	
Plug-in modules.	Reference
On/Off output	4825 0080
RS485 MODBUS® communication	4825 0082
3 inputs , 1 output	4825 0083

Accessories	Available for order in multiples of	Reference
IP65 rating	1	4825 0089
Flush-mounting kit for cutout 144 x 96 mm	1	4825 0088
3-pole fused disconnect switches to protect input voltages (RM type)	4	5601 0018
1-pole + neutral fused disconnect switches to protect the auxiliary supply (RM type)	6	5601 0017
0.5 A 10x38 gG fuses	10	6012 0000
Ferrite for use with communication modules	1	4899 0011
Current transformer range	1	See "TE sensors" pages
Software associated with DIRIS	See "Easy Config System" pages	
Automatic CT short-circuiting device	See "Current transformers" pages	

Expert Services



EXPERT
SERVICES

Study, definition , advice, implementation , maintenance and training ...
Our "Expert Services" experts offer complete support for the success of your project.